


CROSSING INFORMATION		PIPELINE CONTENT DETAILS	
LOCATION:	RADFORD RD. EAGLE LAKE, FL	CARRIER PIPE	CASING PIPE
LATITUDE:	27° 56' 60" N	POTABLE WATER	NONE
LONGITUDE:	81° 47' 32" W	OUTSIDE DIAMETER	N/A
LETTER	DESCRIPTION	PIPE MATERIAL	N/A
A	DISTANCE FROM CROSSING TO NEAREST ACTUAL MILEPOST OR DISTANCE FROM CROSSING TO CENTERLINE OF NEAREST PUBLIC ROAD INTERSECTION	HIGH DENSITY POLYETHYLENE (HDPE)	N/A
B	WIDTH OF RAILROAD RIGHT-OF-WAY	AWWA C906, DR 11	N/A
C	DISTANCE FROM CENTERLINE OF TRACK TO RIGHT-OF-WAY	WALL THICKNESS	N/A
D	TOTAL LENGTH OF PIPE IN RIGHT-OF-WAY	ACTUAL WORKING PRESSURE	N/A
E	DISTANCE FROM CENTERLINE OF TRACK TO START/END OF HORIZONTAL DIRECTION DRILL BORE	TYPE OF JOINT	N/A
F	ANGLE OF CROSSING	COATING	N/A
G	DISTANCE OF SHUT-OFF VALVES FROM CENTERLINE OF NEAREST TRACK	METHOD OF INSTALLATION	N/A
		CATHODIC PROTECTION	N/A
		VENTS	N/A
			TYPE: N/A
			NUMBER: N/A

**811** **Florida's Standard** **Call before you dig.** **www.811.org**

KEY PLAN

 202 EAST BROMFIELD STREET, SUITE 1400 PALM BEACH, FL 33480 (561) 851-1000		 200 W. WASHINGTON ST., SUITE 100 PALM BEACH, FL 33480 (561) 851-1000		 200 W. WASHINGTON ST., SUITE 100 PALM BEACH, FL 33480 (561) 851-1000	
PROJECT NO. 2023-001 DATE OCTOBER 2023 SUBMITTED FOR FLORIDA ANDLAND PERMITTING DESCRIPTION		THIS BOX RESERVED FOR DIGITAL SIGNATURES DESIGNED BY [ ] CHECKED BY [ ] DRAWN BY [ ] DATE [ ]		VERIFY SCALE: 0 1" = 100' (AS SHOWN) BAR IS ONE INCH ON ORIGINAL DRAWING PLAN VIEW IF NOT ONE INCH ON ORIGINAL DRAWING, SCALE IS INDICATED	
POLK REGIONAL WATER COOPERATIVE SOUTHEAST WATER TRANSMISSION MAIN CONSTRUCTION PACKAGE NO. 05 CRUSA		JOB NO. 2023-001 DRAWING NO. 11 SHEET NO. 01 OF 02		PROJECT NO. 2023-001 DATE OCTOBER 2023 SUBMITTED FOR FLORIDA ANDLAND PERMITTING DESCRIPTION	

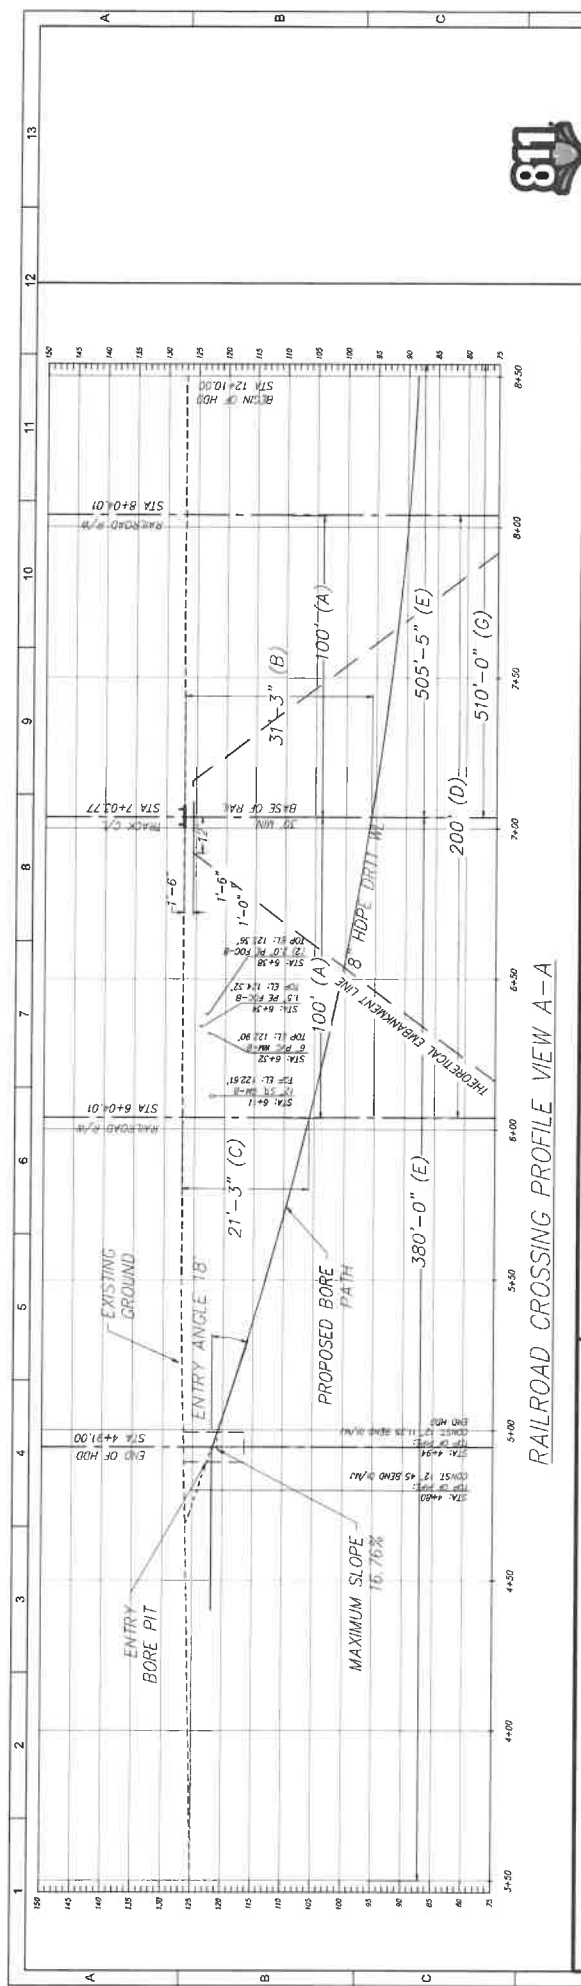

CROSSING INFORMATION		PIPELINE CONTENT DETAILS	
LOCATION:	RADFORD RD. EAGLE LAKE, FL	CARRIER PIPE	POTABLE WATER
LATITUDE:	27° 56' 60" N	CONTENTS TO BE HANDLED	NONE
LONGITUDE:	81° 47' 32" W	OUTSIDE DIAMETER	N/A
LEGEND	DESCRIPTION	PIPE MATERIAL	HIGH DENSITY POLYETHYLENE (HDPE)
	A	SPECIFICATION AND GRADE	AWWA C906, DR 11
	B	ACTUAL WORKING PRESSURE	0.823 INCHES
	C	TYPE OF JOINT	80 PSI
	D	COATING	FUSION WELD
	E	METHOD OF INSTALLATION	NONE
	F	CATHODIC PROTECTION	HORIZONTAL DIRECTIONAL DRILL
G	VENTS	NO	
	TYPE: N/A		
	NUMBER: N/A		

**811**  
Have water before you dig.  
Call before you dig.  
www.811.com

KEY PLAN

SCALE: 1" = 20' (HORIZ)  
SCALE: 1" = 10' (VERT)

VERIFY SCALE:  ORIGINAL DRAWING  
 ORIGINAL DRAWING  
SCALE: 1" = 20' (HORIZ)  
SCALE: 1" = 10' (VERT)

JOB NO. 8825.03  
DRAWING NO. 0  
PROFILE VIEW  
SHEET NO. 02 OF 02

POLK REGIONAL WATER COOPERATIVE  
SOUTHEAST WATER TRANSMISSION MAIN  
CONSTRUCTION PACKAGE NO. 05  
CRUSA

**ChastainSkillman**  
**BCCM**

**carollo**  
200 EAST ROBINSON STREET, SUITE 1400  
ANN ARBOR, MI 48104  
CA NO. 8571

**Polk Regional Water Cooperative**  
1000 W. 10th St., Suite 100  
Tallahassee, FL 32304  
CA NO. 8571

REV	DATE	BY	DESCRIPTION
P-01	OCT-22	BNM	SUBMITTAL FOR FL PERMITS AND PERMITTING

DESIGNED	CHECKED	DATE
AMAS	BNM	OCTOBER 2023