

SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
WATER USE PERMIT
Individual
PERMIT NO. 20 021061.000

PERMIT ISSUE DATE: **December 02, 2022**

EXPIRATION DATE: **December 02, 2032**

The Permittee is responsible for submitting an application to renew this permit no sooner than one year prior to the expiration date, and no later than the end of the last business day before the expiration date, whether or not the Permittee receives prior notification by mail. Failure to submit a renewal application prior to the expiration date and continuing to withdraw water after the expiration date is a violation of Chapter 373, Florida Statutes, and Chapter 40D-2, Florida Administrative Code, and may result in a monetary penalty and/or loss of the right to use the water. Issuance of a renewal of this permit is contingent upon District approval.

TYPE OF APPLICATION: New

GRANTED TO: T. Mims Corp/Attn: Tom Mims
439 S Florida Avenue, Suite 202
Lakeland, FL 33801

PROJECT NAME: Mims Laurel Lake Park

WATER USE CAUTION AREA(S): SOUTHERN WATER USE CAUTION AREA

COUNTY: Polk

TOTAL QUANTITIES AUTHORIZED UNDER THIS PERMIT (in gallons per day)	
ANNUAL AVERAGE	316,300 gpd
PEAK MONTH ¹	667,400 gpd
DROUGHT ANNUAL AVERAGE ²	337,900 gpd

1. Peak Month: Average daily use during the highest water use month.
2. Drought Annual Average: Annual average limit when less than historical average rainfall if sufficient Water Conservation credits exist in the Permittee's account.

ABSTRACT:

This is a new water use permit for public supply use. The project repurposes former phosphate mining land for a mobile home park, **with potable demand met by groundwater withdrawals and irrigation demand met exclusively by surface water withdrawals from man-made lakes within the project area. Quantities for public supply use are based on a per capita rate of 50 gallons per person per day (gpcd) and a functional population of 3,124 persons by the Year 2025.** Quantities for irrigation demand are based on the District's irrigation allotment calculation program, AGMOD. This permit is located within both the Southern Water Use Caution Area (SWUCA), and the Central Florida Water Initiative (CFWI) area and relies exclusively on a source of alternative water supply (AWS) to meet irrigation demand.

Special conditions include that those require the Permittee to report monthly meter readings, to comply with the authorized quantities, to perform meter accuracy checks every five years, maintain a per capita rate of 50 gpcd, to provide offsets for any **groundwater demands beyond those projected for 2025,** to submit the Public Supply Annual Report by April 1 each year, to implement and maintain the Annual Conservation Goal Implementation Plan, and to construct the proposed wells per the approved specifications.

WATER USE TABLE (in gpd)

<u>USE</u>	<u>ANNUAL AVERAGE</u>	<u>PEAK MONTH</u>	<u>DROUGHT ANNUAL AVERAGE</u>
Landscape/Recreation	156,500	475,700	178,100
Public Supply	159,800	191,700	159,800

USES AND IRRIGATION ALLOCATION RATE TABLE

<u>CROP/USE TYPE</u>	<u>IRRIGATED ACRES</u>	<u>IRRIGATION METHOD</u>	<u>STANDARD IRRIGATION RATE</u>	<u>DROUGHT IRRIGATION RATE</u>
Lawn & Landscape Irrigation	74.50	Sprinkler Over Plant	28.20"/yr.	32.14"/yr.
Residential Mobile Home				

PUBLIC SUPPLY:

Population Served: 3,124
 Per Capita Rate: 50 gpd/person

WITHDRAWAL POINT QUANTITY TABLE


Water use from these withdrawal points are restricted to the quantities given below :

<u>I.D. NO. PERMITTEE/ DISTRICT</u>	<u>DIAM (in.)</u>	<u>DEPTH TTL./CSD.FT. (feet bls)</u>	<u>USE DESCRIPTION</u>	<u>AVERAGE (gpd)</u>	<u>PEAK MONTH (gpd)</u>
PW-1 / 1	8	500 / 225	Public Supply	159,800	191,700
PW-2 / 2	8	500 / 225	Public Supply	159,800	191,700
Standby					
PS-1 / 3	8	N/A / N/A	Irrigation	156,500	475,700
PS-2 / 4	8	N/A / N/A	Irrigation	156,500	475,700
Standby					

WITHDRAWAL POINT LOCATION TABLE

<u>DISTRICT I.D. NO.</u>	<u>LATITUDE/LONGITUDE</u>
1	27° 51' 01.35"/81° 59' 52.27"
2	27° 51' 01.71"/81° 59' 52.94"
3	27° 51' 01.29"/81° 59' 49.55"
4	27° 51' 01.43"/81° 59' 49.31"

Location Map
T. Mims Corp/Attn: Tom Mims
WUP No. 20 021061.000

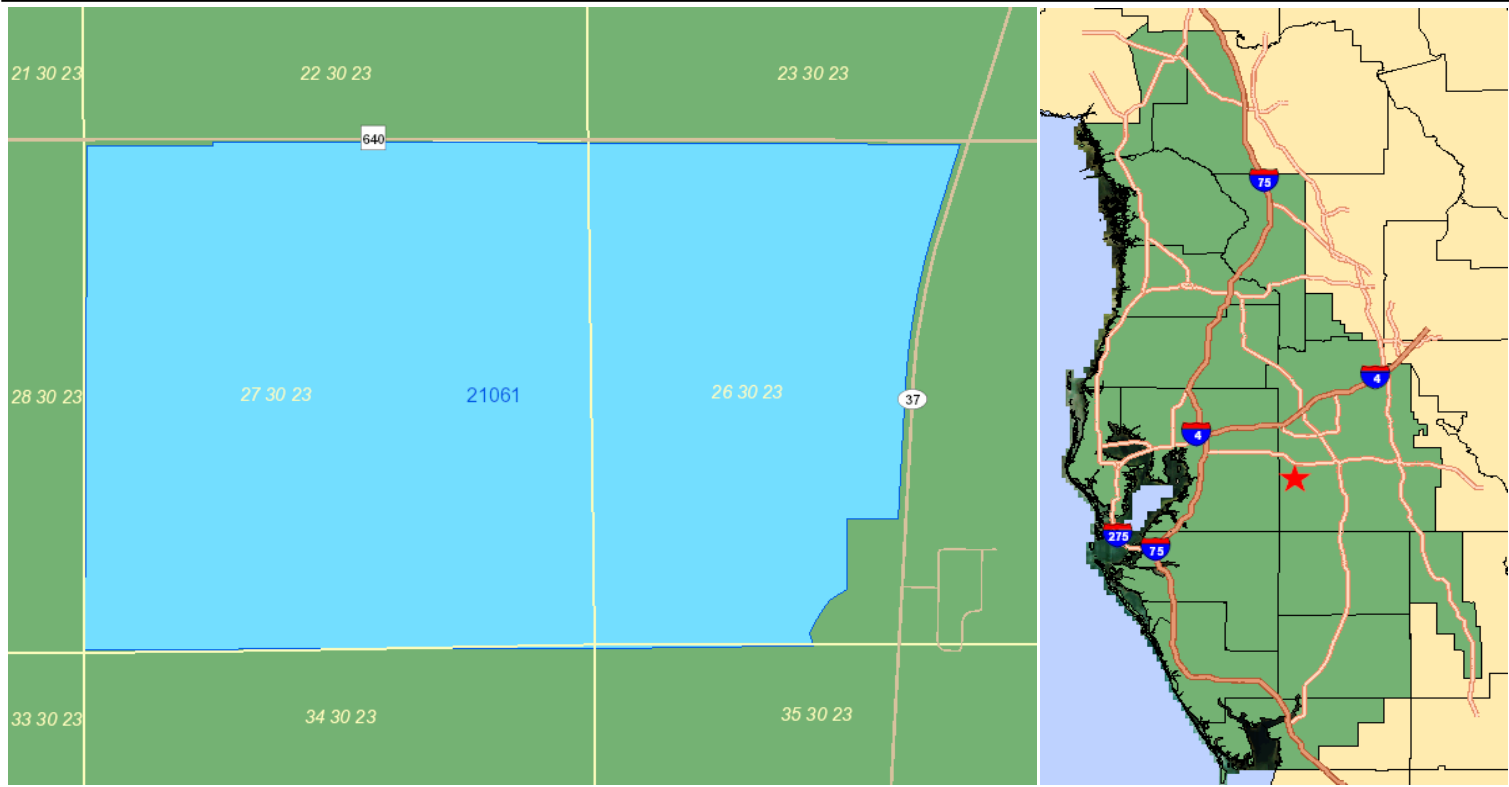

Legend

- DIDs
- WUP Boundary
- Natural Color Imagery

POLK COUNTY

Southwest Florida
Water Management District

STANDARD CONDITIONS:

The Permittee shall comply with the Standard Conditions attached hereto, incorporated herein by reference as Exhibit A and made a part hereof.

SPECIAL CONDITIONS:

1. All reports and data required by condition(s) of the permit shall be submitted to the District according to the due date(s) contained in the specific condition. If the condition specifies that a District-supplied form is to be used, the Permittee should use that form in order for their submission to be acknowledged in a timely manner. The only alternative to this requirement is to use the District Permit Information Center (www.swfwmd.state.fl.us/permits/epermitting/) to submit data, plans or reports online. There are instructions at the District website on how to register to set up an account to do so. If the report or data is received on or before the tenth day of the month following data collection, it shall be deemed as a timely submittal.

All mailed reports and data are to be sent to:

Southwest Florida Water Management District
Tampa Service Office, Water Use Permit Bureau
7601 U.S. Hwy. 301 North
Tampa, Florida 33637-6759

Submission of plans and reports: Unless submitted online or otherwise indicated in the special condition, the original and two copies of each plan and report, such as conservation plans, environmental analyses, aquifer test results, per capita annual reports, etc. are required.

Submission of data: Unless otherwise indicated in the special condition, an original (no copies) is required for data submittals such as crop report forms, meter readings and/or pumpage, rainfall, water level, evapotranspiration, or water quality data.
(499)

2. The quantities included in the permit are based on an average per capita rate of 50. By rule, the per capita rate in any given year shall not exceed 150 gpd. However, failure to maintain, on average, the per capita rate on which the permitted quantity is based could result in noncompliance with the terms of the permit. The per capita rate will be monitored via the Annual Report and the Reclaimed Water Supplier Report that are required to be submitted by April 1 of each year for the term of the permit.(67)
3. This permit shall be modified if an additional source of water is provided for public supply use from a separate entity. This includes additional Alternative Water Supply quantities and irrigation water for lawn/landscape and common areas. The Permittee shall notify the District of the additional water source and submit an application to modify the permit to acknowledge receipt.(68)
4. By December 31, 2023, if the permittee's permit duration extends beyond 2025 and the projected water demand at the end of the permit term exceeds the allocation authorized under section 2.8 of the CFWI Supplemental Applicant's handbook, then the permittee shall submit a plan to the District describing how the remainder of its demand will be met (e.g. offsets, substitution credits, land use transitions, redistributed uses, alternative water supply development). The plan shall propose projects and identify a schedule for implementation. Annual updates shall be due on December 31 of each subsequent year detailing progress shall be provided to the District. The annual status reports shall include work completed to date, expenditures, and any anticipated changes in timelines.(90)
5. The permittee's per capita water use rate shall be monitored via the Annual Report that is required to be submitted by April 1 of each year for the term of the permit. permittees within the CFWI may use the "Public Supply Annual Report," referred to in section 2.7.3.1 of the CFWI Supplemental Applicant's Handbook as Design Aid 3, to assist with properly documenting the information that must be included in the Annual Report. At a minimum, the Annual Report must contain the following information:
 - a. Calculation of the Alternative Per Capita Water Use Rate pursuant to section 2.7.3. All components of the Alternative Per Capita Water Use Rate equation are subject to the requirements set forth in section 2.7.3.1(A) of the CFWI Supplemental Applicant's Handbook.
 - b. Documentation of each component of the Alternative Per Capita Water Use Rate equation, as

applicable, pursuant to section 2.7.3.1(A) of the CFWI Supplemental Applicant's Handbook.

c. A service area map or file showing the current utility service area. Any changes to the utility service area relative to the existing boundaries in the District's Geographic Information System (GIS) layer must be identified and documented.

d. Residential water use, which consists of the indoor and outdoor water uses associated with each category of residential customer (single family units, multi-family units, and mobile homes), including irrigation uses, whether separately metered or not. The permittee shall document the methodology used to determine the number of dwelling units by type and the quantities used. Estimates of water use based upon meter size will not be accepted. If mobile homes are included in the permittees multi-family unit category, the information for them does not have to be separated. The information for each category shall include:

Number of dwelling units per category;

Number of domestic metered connections per category;

Number of metered irrigation connections;

Annual average quantities in gallons per day provided to each category; and

Percentage of the total residential water use provided apportioned to each category.

e. Non-residential water use, which consists of all quantities provided for use in a community not directly associated with places of residence. For each category below, the permittee shall include annual average gpd provided, the percent of total non-residential use quantities provided, and the number of metered connections:

Industrial/commercial/institutional uses, including those associated lawn and landscape irrigation use;

Agricultural uses (e.g., irrigation of a nursery);

Recreation/Aesthetic, including irrigation (excluding golf courses) of common areas, stadiums, and school yards;

Golf course irrigation;

Firefighting, system testing and other accounted uses;

K-through-12 schools that do not serve any of the service area population; and

Water loss, defined as the difference between the output from the treatment plant and accounted residential water use (iv above), non-residential and estimated unmetered use (this section), and treatment losses.

f. A water audit report, if water losses are greater than 10% of the total distribution quantities. The water audit shall include: Evaluation of:

(1) leakage associated with transmission and distribution mains;

(2) overflow and leakage from storage tanks;

(3) leakage near service connections;

(4) illegal connections;

(5) description and explanations for excessive distribution line flushing (greater than 1% of the treated water volume delivered to the distribution system) for potability;

(6) fire suppression;

(7) un-metered system testing;

(8) under-registration of meter; and

(9) other discrepancies between the metered amount of finished water output from the treatment plant less the metered amounts used for residential and non-residential uses specified in Parts 4 and 5 above, and A schedule for a remedial action-plan to reduce water losses below 10%.

g. If the permittee cannot achieve the Public Supply Use Type Annual Conservation Goal according to the time frames included in section 2.7.3.1.C, the Annual Report shall include an explanation detailing why the per capita water use rate was not achieved and measures taken to comply with the Annual Conservation Goal.

3. In addition to the Annual Report required by section 2.7.3.1 of the CFWI Supplemental Applicant's Handbook, permittees in the Southern Water Use Caution Area and the Dover/Plant City Water Use Caution Area shall submit Parts D through E of the "Public Supply Annual Report For Individual Permits Over 100,000 GPD Annual Average Quantities Form" (Form No. LEG-R.103.00 (5/14)), and all required attachments, including the Public Supply Service Area General Information Form, by April 1 of each year.

(91)

6. The permittee shall develop and maintain an Annual Conservation Goal Implementation Plan (ACGIP) pursuant to section 2.7 of the CFWI Supplemental Applicant's Handbook for Consumptive Use Permitting. The ACGIP shall outline conservation goals for no less than 5 years. Agricultural permittees implementing BMPs in lieu of an ACGIP must maintain documentation supporting the enrollment and

implementation of selected BMPs. The permittee shall submit the ACGIP upon request by the District, during a 10-year compliance report, and with an application for permit renewal or modification except for a public water supply permittee with an annual average daily quantity of 100,000 gpd or greater and whose commercial use equals or exceeds 30 percent of its total water use, shall report its progress toward achieving the conservation goals within the ACGIP annually.(92)

7. The Permittee shall construct the proposed wells according to the surface diameter and casing depth specifications below. The casing shall be continuous from land surface to the minimum depth stated and is specified to prevent the unauthorized interchange of water between different water bearing zones. If a total depth is listed below, this is an estimate, based on best available information, of the depth at which high producing zones are encountered. However, it is the Permittee's responsibility to have the water in the well sampled during well construction, before reaching the estimated total depth. Such sampling is necessary to ensure that the well does not encounter water quality that cannot be utilized by the Permittee, and to ensure that withdrawals from the well will not cause salt-water intrusion. All depths given are in feet below land surface. For Well Construction requirements see Exhibit B, Well Construction Instructions, attached to and made part to this permit.

District ID Nos. 1 and 2, Permittee ID Nos. 1 and 2, having a surface diameter of 8 inches, with a minimum casing depth of 225 feet, drilled to an estimated total depth of 500 feet.
(240)

8. The Permittee shall submit a copy of the well completion reports to the District's Water Use Permit Bureau, within 30 days of each well completion.(583)
9. This Permit is located within the Southern Water Use Caution Area (SWUCA). Pursuant to Section 373.0421, Florida Statutes, the SWUCA is subject to a minimum flows and levels recovery strategy, which became effective on January 1, 2007. The Governing Board may amend the recovery strategy, including amending applicable water use permitting rules based on an annual assessment of water resource criteria, cumulative water withdrawal impacts, and on a recurring five-year evaluation of the status of the recovery strategy up to the year 2025 as described in Chapter 40D-80, Florida Administrative Code. This Permit is subject to modification to comply with new rules.(652)
10. The Permittee shall submit a "Public Supply Annual Report" to the District by April 1 of each year on their water use during the preceding calendar year using the form, "Public Supply Water Use Annual Report Form" (Form No. LEG-R.103.00 (05/14)), referred to in this condition as "the Form," and all required attachments and documentation. The Permittee shall adhere to the "Annual Report Submittal Instructions" attached to and made part of this condition in Exhibit B. The Form addresses the following components in separate sections.

Per Capita Use Rate

A per capita rate for the previous calendar year will be calculated as provided in Part A of the Form using Part C of the Form to determine Significant Use deduction that may apply. Permittees that cannot achieve a per capita rate of 150 gpd according to the time frames included in the "Instructions for Completion of the Water Use Annual Report," shall include a report on why this rate was not achieved, measures taken to comply with this requirement, and a plan to bring the permit into compliance.

Residential Use

Residential use shall be reported in the categories specified in Part B of the Form, and the methodology used to determine the number of dwelling units by type and their quantities used shall be documented in an attachment.

Non-Residential Use

Non-residential use quantities provided for use in a community but that are not directly associated with places of residence, as well as the total water losses that occur between the point of output of the treatment plant and accountable end users, shall be reported in Part B of the Form.

Water Conservation

In an attachment to the Form, the Permittee shall describe the following:

1. Description of any ongoing audit program of the water treatment plant and distribution systems to address reductions in water losses.
2. An update of the water conservation plan that describes and quantifies the effectiveness of

measures currently in practice, any additional measures proposed to be implemented, the scheduled implementation dates, and an estimate of anticipated water savings for each additional measure.

3. A description of the Permittees implementation of water-efficient landscape and irrigation codes or ordinances, public information and education programs, water conservation incentive programs, identification of which measures and programs, if any, were derived from the Conserve Florida Water Conservation Guide, and provide the projected costs of the measures and programs and the projected water savings.

Water Audit

If the current water loss rate is greater than 10% of the total distribution quantities, a water audit as described in the "Instructions for Completion of the Water Use Annual Report" shall be conducted and completed by the following July 1, with the results submitted by the following October 1. Indicate on Part A of the Form whether the water audit was done, will be done, or is not applicable.

Alternative Water Supplied Other Than Reclaimed Water

If the Permittee provides Alternative Water Supplies other than reclaimed water (e.g., stormwater not treated for potable use) to customers, the information required on Part D of the Form shall be submitted along with an attached map depicting the areas of current Alternative Water Use service and areas that are projected to be added within the next year.

Suppliers of Reclaimed Water

1. Permittees having a wastewater treatment facility with an annual average design capacity equal to or greater than 100,000 gpd:

The Permittee shall submit the "SWFWMD Annual Reclaimed Water Supplier Report" on quantities of reclaimed water that was provided to customers during the previous fiscal year (October 1 to September 30). The report shall be submitted in Excel format on the Compact Disk, Form No. LEG-R.026.00 (05/09), that will be provided annually to them by the District. A map depicting the area of reclaimed water service that includes any areas projected to be added within the next year, shall be submitted with this report.

2. Permittees that have a wastewater treatment facility with an annual average design capacity less than 100,000 gpd:

a. The Permittee has the option to submit the "SWFWMD Annual Reclaimed Water Supplier Report," Form No. LEG-R.026.00, as described in sub-part (1) above, or

b. Provide information on reclaimed water supplied to customers on Part E of the Form as described in the "Instructions for Completion of the Water Use Annual Report".

Updated Service Area Map

If there have been changes to the service area since the previous reporting period, the Permittee shall update the service area using the map that is maintained in the District's Mapping and GIS system. (660)

11. The following proposed withdrawal facilities shall be metered within 90 days of completion of construction of the facilities: District ID No(s). 1, 2, 3, and 4, Permittee ID No(s). 1, 2, 3, and 4. Monthly meter reading and reporting, as well as meter accuracy checks every five years shall be in accordance with instructions in Exhibit B, Metering Instructions, attached to and made part of this permit.(718)
12. The withdrawals and associated quantities authorized by this Water Use Permit are not available for use by the Permittee until such time as the related Environmental Resource Permit(s) has been approved for the residential development and stormwater management system.(990)

40D-2
Exhibit A

WATER USE PERMIT STANDARD CONDITIONS

1. With advance notice to the Permittee, District staff with proper identification shall have permission to enter, inspect, collect samples, take measurements, observe permitted and related facilities and collect and document any information deemed necessary to determine compliance with the approved plans, specifications and conditions of this permit. The Permittee shall either accompany District staff onto the property or make provision for access onto the property.
2. When necessary to analyze impacts to the water resource or existing users, the District shall require the Permittee to install flow metering or other measuring devices to record withdrawal quantities and submit the data to the District.
3. A District identification tag shall be prominently displayed at each withdrawal point that is required by the District to be metered or for which withdrawal quantities are required to be reported to the District, by permanently affixing the tag to the withdrawal facility.
4. The Permittee shall mitigate any adverse impact to environmental features or offsite land uses as a result of withdrawals. When adverse impacts occur or are imminent, the District shall require the Permittee to mitigate the impacts. Examples of adverse impacts include the following:
 - A. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses; or
 - B. Damage to crops and other vegetation causing financial harm to the owner; and
 - C. Damage to the habitat of endangered or threatened species.
5. The Permittee shall mitigate any adverse impact to existing legal uses caused by withdrawals. When adverse impacts occur or are imminent, the District may require the Permittee to mitigate the impacts. Adverse impacts include:
 - A. A reduction in water levels which impairs the ability of a well to produce water;
 - B. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses; or
 - C. Significant inducement of natural or manmade contaminants into a water supply or into a usable portion of an aquifer or water body.
6. Permittee shall notify the District in writing within 30 days of any sale, transfer, or conveyance of ownership or any other loss of permitted legal control of the Project and / or related facilities from which the permitted consumptive use is made. Where Permittee's control of the land subject to the permit was demonstrated through a lease, the Permittee must either submit documentation showing that it continues to have legal control or transfer control of the permitted system / project to the new landowner or new lessee. All transfers of ownership are subject to the requirements of Rule 40D-1.6105, F.A.C. Alternatively, the Permittee may surrender the consumptive use permit to the District, thereby relinquishing the right to conduct any activities under the permit.
7. All withdrawals authorized by this WUP shall be implemented as conditioned by this permit, including any documents submitted as part of the permit application incorporated by reference in a permit condition. This permit is subject to review and modification, enforcement action, or revocation, in whole or in part, pursuant to Section 373.136 or 373.243, F.S.
8. This permit does not convey to the Permittee any property rights or privileges other than those specified herein, nor relieve the Permittee from complying with any applicable local government, state, or federal law, rule, or ordinance.
9. The Permittee shall cease or reduce surface water withdrawal as directed by the District if water levels in lakes fall below the applicable minimum water level established in Chapter 40D-8, F.A.C., or rates of flow in streams fall below the minimum levels established in Chapter 40D-8, F.A.C.
10. The Permittee shall cease or reduce withdrawal as directed by the District if water levels in aquifers fall below the minimum levels established by the Governing Board.

11. A Permittee may seek modification of any term of an unexpired permit. The Permittee is advised that section 373.239, F.S., and Rule 40D-2.331, F.A.C., are applicable to permit modifications.
12. The Permittee shall practice water conservation to increase the efficiency of transport, application, and use, as well as to decrease waste and to minimize runoff from the property. At such time as the Governing Board adopts specific conservation requirements for the Permittee's water use classification, this permit shall be subject to those requirements upon notice and after a reasonable period for compliance.
13. The District may establish special regulations for Water-Use Caution Areas. At such time as the Governing Board adopts such provisions, this permit shall be subject to them upon notice and after a reasonable period for compliance.
14. Nothing in this permit should be construed to limit the authority of the District to declare a water shortage and issue orders pursuant to chapter 373, F.S. In the event of a declared water shortage, the Permittee must adhere to the water shortage restrictions, as specified by the District. The Permittee is advised that during a water shortage, reports shall be submitted as required by District rule or order.
15. This permit is issued based on information provided by the Permittee demonstrating that the use of water is reasonable and beneficial, consistent with the public interest, and will not interfere with any existing legal use of water. If, during the term of the permit, it is determined by the District that a statement in the application and in the supporting data are found to be untrue and inaccurate, the use is not reasonable and beneficial, in the public interest, or does impact an existing legal use of water, the Governing Board shall modify this permit or shall revoke this permit following notice and hearing, pursuant to sections 373.136 or 373.243, F.S. The Permittee shall immediately notify the District in writing of any previously submitted information that is later discovered to be inaccurate.
16. Within the Southern Water Use Caution Area, if the District determines that significant water quantity or quality changes, impacts to existing legal uses, or adverse environmental impacts are occurring, the District, upon reasonable notice to the Permittee, including a statement of facts upon which the District based its determination, may reconsider the quantities permitted or other conditions of the permit as appropriate to address the change or impact, but only after an opportunity for the Permittee to resolve or mitigate the change or impact or to request a hearing.
17. All permits are contingent upon continued ownership or legal control of all property on which pumps, wells, diversions or other water withdrawal facilities are located.

Exhibit B
Instructions

METERING INSTRUCTIONS

The Permittee shall meter withdrawals from surface waters and/or the ground water resources, and meter readings from each withdrawal facility shall be recorded on a monthly basis within the last week of the month. The meter reading(s) shall be reported to the Water Use Permit Bureau on or before the tenth day of the following month for monthly reporting frequencies. For bi-annual reporting, the data shall be recorded on a monthly basis and reported on or before the tenth day of the month following the sixth month of recorded data. The Permittee shall submit meter readings online using the Permit Information Center at www.swfwmd.state.fl.us/permits/epermitting/ or on District supplied scanning forms unless another arrangement for submission of this data has been approved by the District. Submission of such data by any other unauthorized form or mechanism may result in loss of data and subsequent delinquency notifications. Call the Water Use Permit Bureau in Tampa at (813) 985-7481 if difficulty is encountered.

The meters shall adhere to the following descriptions and shall be installed or maintained as follows:

1. The meter(s) shall be non-resettable, totalizing flow meter(s) that have a totalizer of sufficient magnitude to retain total gallon data for a minimum of the three highest consecutive months permitted quantities. If other measuring device(s) are proposed, prior to installation, approval shall be obtained in writing from the Water Use Permit Bureau Chief.
2. The Permittee shall report non-use on all metered standby withdrawal facilities on the scanning form or approved alternative reporting method.
3. If a metered withdrawal facility is not used during any given month, the meter report shall be submitted to the District indicating the same meter reading as was submitted the previous month.
4. The flow meter(s) or other approved device(s) shall have and maintain an accuracy within five percent of the actual flow as installed.
5. Meter accuracy testing requirements:
 - A. For newly metered withdrawal points, the flow meter installation shall be designed for inline field access for meter accuracy testing.
 - B. The meter shall be tested for accuracy on-site, as installed according to the Flow Meter Accuracy Test Instructions in this Exhibit B, every five years in the assigned month for the county, beginning from the date of its installation for new meters or from the date of initial issuance of this permit containing the metering condition with an accuracy test requirement for existing meters.
 - C. The testing frequency will be decreased if the Permittee demonstrates to the satisfaction of the District that a longer period of time for testing is warranted.
 - D. The test will be accepted by the District only if performed by a person knowledgeable in the testing equipment used.
 - E. If the actual flow is found to be greater than 5% different from the measured flow, within 30 days, the Permittee shall have the meter re-calibrated, repaired, or replaced, whichever is necessary. Documentation of the test and a certificate of re-calibration, if applicable, shall be submitted within 30 days of each test or re-calibration.
6. The meter shall be installed according to the manufacturer's instructions for achieving accurate flow to the specifications above, or it shall be installed in a straight length of pipe where there is at least an upstream length equal to ten (10) times the outside pipe diameter and a downstream length equal to two (2) times the outside pipe diameter. Where there is not at least a length of ten diameters upstream available, flow straightening vanes shall be used in the upstream line.
7. Broken or malfunctioning meter:
 - A. If the meter or other flow measuring device malfunctions or breaks, the Permittee shall notify the District within 15 days of discovering the malfunction or breakage.
 - B. The meter must be replaced with a repaired or new meter, subject to the same specifications given above, within 30 days of the discovery.
 - C. If the meter is removed from the withdrawal point for any other reason, it shall be replaced with another meter having the same specifications given above, or the meter shall be reinstalled within 30 days of its removal from the withdrawal. In either event, a fully functioning meter shall not be off the withdrawal point for more than 60 consecutive days.
8. While the meter is not functioning correctly, the Permittee shall keep track of the total amount of time the withdrawal point was used for each month and multiply those minutes times the pump capacity (in gallons per minute) for total gallons. The estimate of the number of gallons used each month during that period shall be submitted on District scanning forms and noted as estimated per instructions on the form. If the data is submitted

by another approved method, the fact that it is estimated must be indicated. The reason for the necessity to estimate pumpage shall be reported with the estimate.

9. In the event a new meter is installed to replace a broken meter, it and its installation shall meet the specifications of this condition. The permittee shall notify the District of the replacement with the first submittal of meter readings from the new meter.

FLOW METER ACCURACY TEST INSTRUCTIONS

1. **Accuracy Test Due Date** - The Permittee is to schedule their accuracy test according to the following schedule:
 - A. For existing metered withdrawal points, add five years to the previous test year, and make the test in the month assigned to your county.
 - B. For withdrawal points for which metering is added for the first time, the test is to be scheduled five years from the issue year in the month assigned to your county.
 - C. For proposed withdrawal points, the test date is five years from the completion date of the withdrawal point in the month assigned to your county.
 - D. For the Permittee's convenience, if there are multiple due-years for meter accuracy testing because of the timing of the installation and/or previous accuracy tests of meters, the Permittee can submit a request in writing to the Water Use Permit Bureau Chief for one specific year to be assigned as the due date year for meter testing. Permittees with many meters to test may also request the tests to be grouped into one year or spread out evenly over two to three years.
 - E. The months for accuracy testing of meters are assigned by county. The Permittee is requested but not required to have their testing done in the month assigned to their county. This is to have sufficient District staff available for assistance.

January	Hillsborough
February	Manatee, Pasco
March	Polk (for odd numbered permits)*
April	Polk (for even numbered permits)*
May	Highlands
June	Hardee, Charlotte
July	None or Special Request
August	None or Special Request
September	Desoto, Sarasota
October	Citrus, Levy, Lake
November	Hernando, Sumter, Marion
December	Pinellas

* The permittee may request their multiple permits be tested in the same month.

2. **Accuracy Test Requirements:** The Permittee shall test the accuracy of flow meters on permitted withdrawal points as follows:
 - A. The equipment water temperature shall be set to 72 degrees Fahrenheit for ground water, and to the measured water temperature for other water sources.
 - B. A minimum of two separate timed tests shall be performed for each meter. Each timed test shall consist of measuring flow using the test meter and the installed meter for a minimum of four minutes duration. If the two tests do not yield consistent results, additional tests shall be performed for a minimum of eight minutes or longer per test until consistent results are obtained.
 - C. If the installed meter has a rate of flow, or large multiplier that does not allow for consistent results to be obtained with four- or eight-minute tests, the duration of the test shall be increased as necessary to obtain accurate and consistent results with respect to the type of flow meter installed.
 - D. The results of two consistent tests shall be averaged, and the result will be considered the test result for the meter being tested. This result shall be expressed as a plus or minus percent (rounded to the nearest one-tenth percent) accuracy of the installed meter relative to the test meter. The percent accuracy indicates the deviation (if any), of the meter being tested from the test meter.
3. **Accuracy Test Report:** The Permittees shall demonstrate that the results of the meter test(s) are accurate by submitting the following information within 30 days of the test:
 - A. A completed Flow Meter Accuracy Verification Form, Form LEG-R.101.00 (5/14) for each flow meter tested. This form can be obtained from the District's website (www.watermatters.org) under "ePermitting and Rules" for Water Use Permits.

- B. A printout of data that was input into the test equipment, if the test equipment is capable of creating such a printout;
- C. A statement attesting that the manufacturer of the test equipment, or an entity approved or authorized by the manufacturer, has trained the operator to use the specific model test equipment used for testing;
- D. The date of the test equipment's most recent calibration that demonstrates that it was calibrated within the previous twelve months, and the test lab's National Institute of Standards and Testing (N.I.S.T.) traceability reference number.
- E. A diagram showing the precise location on the pipe where the testing equipment was mounted shall be supplied with the form. This diagram shall also show the pump, installed meter, the configuration (with all valves, tees, elbows, and any other possible flow disturbing devices) that exists between the pump and the test location clearly noted with measurements. If flow straightening vanes are utilized, their location(s) shall also be included in the diagram.
- F. A picture of the test location, including the pump, installed flow meter, and the measuring device, or for sites where the picture does not include all of the items listed above, a picture of the test site with a notation of distances to these items.

WELL CONSTRUCTION INSTRUCTIONS

All wells proposed to be constructed shall be drilled and constructed as specified below:

- 1. All well casing (including liners and/or pipe) must be sealed to the depth specified in the permit condition.
- 2. The proposed well(s) shall be constructed of materials that are resistant to degradation of the casing/grout due to interaction with the water of lesser quality. A minimum grout thickness of two (2) inches is required on wells four (4) inches or more in diameter.
- 3. A minimum of twenty (20) feet overlap and two (2) centralizers is required for Public Supply wells and all wells six (6) inches or more in diameter.
- 4. Any variation from estimated, maximum or minimum total depths; maximum or minimum casing depths; well location or casing diameter specified in the condition requires advanced approval by the Water Use Permit Bureau Chief, or the Well Construction Section Manager.
- 5. The Permittee is notified that a proposal to significantly change any of these well construction specifications may require permit modification if the District determines that such a change would result in significantly greater withdrawal impacts than those considered for this Permit.
- 6. The finished well casing depth shall not vary from these specifications by greater than ten (10) percent unless advance approval is granted by the Water Use Permit Bureau Chief, or the Well Construction Section Manager.

ANNUAL REPORT SUBMITTAL INSTRUCTIONS

The "Public Supply Water Use Annual Report Form" (Form No. LEG-R.023.00 (01/09)), is designed to assist the Permittee with the annual report requirements, but the final authority for what must be included in the Water Use Annual Report is in this condition and in these instructions. Two identical copies of the "Public Supply Water Use Annual Report Form" and two identical copies of all required supporting documentation shall be included if submitted in hard copy. "Identical copy" in this instance means that if the original is in color, then all copies shall also be printed in color. If submitted electronically, only one submittal is required; however, any part of the document that is in color shall be scanned in color.

- 1. **Per Capita Use Rate** - A per capita rate for the previous calendar year will be progressively calculated until a rate of 150 gpd per person or less is determined whether it is the unadjusted per capita, adjusted per capita, or compliance per capita. The calculations shall be performed as shown in Part A of the Form. The Permittee shall refer to and use the definitions and instructions for all components as provided on the Form and in the Water Use Permit Applicant's Handbook Part B. Permittees that have interconnected service areas and receive an annual average quantity of 100,000 gpd or more from another permittee are to include these quantities as imported quantities. Permittees in the Southern Water Use Caution Area (SWUCA) or the Northern Tampa Bay Water Use Caution Area (NTBWUCA), as it existed prior to October 1, 2007, shall achieve a per capita of 150 gpd or less, and those in these areas that cannot achieve a compliance per capita rate of 150 gpd or less shall include a report on why this rate was not achieved, measures taken to comply with this requirement, and a plan to bring the permit into compliance. Permittees not in a Water Use Caution Area that cannot achieve a compliance per capita rate of 150 gpd or less by December 31, 2019 shall submit this same report in the Annual Report due April 1, 2020.
- 2. **Residential Use** - Residential water use consists of the indoor and outdoor water uses associated with each category of residential customer (single family units, multi-family units, and mobile homes), including irrigation

uses, whether separately metered or not. The Permittee shall document the methodology used to determine the number of dwelling units by type and the quantities used. Estimates of water use based upon meter size will not be accepted. If mobile homes are included in the Permittees multi-family unit category, the information for them does not have to be separated. The information for each category shall include:

- A. Number of dwelling units per category,
- B. Number of domestic metered connections per category,
- C. Number of metered irrigation connections,
- D. Annual average quantities in gallons per day provided to each category, and
- E. Percentage of the total residential water use provided apportioned to each category.

3. **Non-Residential Use** - Non-residential use consists of all quantities provided for use in a community not directly associated with places of residence. For each category below, the Permittee shall include annual average gpd provided and percent of total non-residential use quantities provided. For each category 1 through 6 below, the number of metered connections shall be provided. These non-residential use categories are:

- A. Industrial/commercial uses, including associated lawn and landscape irrigation use,
- B. Agricultural uses (e.g., irrigation of a nursery),
- C. Recreation/Aesthetic, for example irrigation (excluding golf courses) of Common Areas, stadiums and school yards,
- D. Golf course irrigation,
- E. Fire fighting, system testing and other accounted uses,-
- F. K-through-12 schools that do not serve any of the service area population, and
- G. Water Loss as defined as the difference between the output from the treatment plant and accounted residential water use (B above) and the listed non-residential uses in this section.

4. **Water Audit** - The water audit report that is done because water losses are greater than 10% of the total distribution quantities shall include the following items:

- A. Evaluation of:
 - 1) leakage associated with transmission and distribution mains,
 - 2) overflow and leakage from storage tanks,
 - 3) leakage near service connections,
 - 4) illegal connections,
 - 5) description and explanations for excessive distribution line flushing (greater than 1% of the treated water volume delivered to the distribution system) for potability,
 - 6) fire suppression,
 - 7) un-metered system testing,
 - 8) under-registration of meters, and
 - 9) other discrepancies between the metered amount of finished water output from the treatment plant less the metered amounts used for residential and non-residential uses specified in Parts B and C above, and
- B. A schedule for a remedial action-plan to reduce the water losses to below 10%.

5. **Alternative Water Supplied other than Reclaimed Water** - Permittees that provide Alternative Water Supplies other than reclaimed water (e.g., stormwater not treated for potable use) shall include the following on Part D of the Form:

- A. Description of the type of Alternative Water Supply provided,
- B. County where service is provided,
- C. Customer name and contact information,
- D. Customer's Water Use Permit number (if any),
- E. Customer's meter location latitude and longitude,
- F. Meter ownership information,
- G. General customer use category,
- H. Proposed and actual flows in annual average gallons per day (gpd) per customer,
- I. Customer cost per 1,000 gallons or flat rate information,
- J. Delivery mode (e.g., pressurized or non-pressurized),
- K. Interruptible Service Agreement (Y/N),
- L. Month/year service began, and

- M. Totals of monthly quantities supplied.
6. **Suppliers of Reclaimed Water** - Depending upon the treatment capacity of the Permittees wastewater treatment plant, the Permittee shall submit information on reclaimed water supplied as follows:
- A. Permittees having a wastewater treatment facility with an annual average design capacity equal to or greater than 100,000 gpd shall utilize the "SWFWMD Annual Reclaimed Water Supplier Report" in Excel format on the Compact Disk, Form No. LEG-R.026.00 (05/09). The "SWFWMD Annual Reclaimed Water Supplier Report" is described in Section 3.1 of Chapter 3, under the subheading "Reclaimed Water Supplier Report" and is described in detail in the Water Use Permit Applicant's Handbook Part B.
- B. Permittees that have a wastewater treatment facility with an annual average design capacity less than 100,000 gpd can either utilize the "SWFWMD Annual Reclaimed Water Supplier Report," Form No. LEG-R.026.00, as described in sub-part (1) above or provide the following information on Part E of the Form:
- 1) Bulk customer information:
 - a) Name, address, telephone number,
 - b) WUP number (if any),
 - c) General use category (residential, commercial, recreational, agricultural irrigation, mining),
 - d) Month/year first served,
 - e) Line size,
 - f) Meter information, including the ownership and latitude and longitude location,
 - g) Delivery mode (pressurized, non-pressurized).
 - 2) Monthly flow in gallons per bulk customer.
 - 3) Total gallons per day (gpd) provided for metered residential irrigation.
 - 4) Disposal information:
 - a) Site name and location (latitude and longitude or as a reference to the service area map),
 - b) Contact name and telephone,
 - c) Disposal method, and
 - d) Annual average gpd disposed.

Darrin W. Herbst, P.G.

Authorized Signature

SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

This permit, issued under the provision of Chapter 373, Florida Statutes and Florida Administrative Code 40D-2, authorizes the Permittee to withdraw the quantities outlined above, and may require various activities to be performed by the Permittee as described in the permit, including the Special Conditions. The permit does not convey to the Permittee any property rights or privileges other than those specified herein, nor relieve the Permittee from complying with any applicable local government, state, or federal law, rule, or ordinance.

Notice of Rights**ADMINISTRATIVE HEARING**

1. You or any person whose substantial interests are or may be affected by the District's intended or proposed action may request an administrative hearing on that action by filing a written petition in accordance with Sections 120.569 and 120.57, Florida Statutes (F.S.), Uniform Rules of Procedure Chapter 28-106, Florida Administrative Code (F.A.C.) and District Rule 40D-1.1010, F.A.C. Unless otherwise provided by law, a petition for administrative hearing must be filed with (received by) the District within 21 days of receipt of written notice of agency action. "Written notice" means either actual written notice, or newspaper publication of notice, that the District has taken or intends to take agency action. "Receipt of written notice" is deemed to be the fifth day after the date on which actual notice is deposited in the United States mail, if notice is mailed to you, or the date that actual notice is issued, if sent to you by electronic mail or delivered to you, or the date that notice is published in a newspaper, for those persons to whom the District does not provide actual notice.
2. Pursuant to Subsection 373.427(2)(c), F.S., for notices of intended or proposed agency action on a consolidated application for an environmental resource permit and use of sovereignty submerged lands concurrently reviewed by the District, a petition for administrative hearing must be filed with (received by) the District within 14 days of receipt of written notice.
3. Pursuant to Rule 62-532.430, F.A.C., for notices of intent to deny a well construction permit, a petition for administrative hearing must be filed with (received by) the District within 30 days of receipt of written notice of intent to deny.
4. Any person who receives written notice of an agency decision and who fails to file a written request for a hearing within 21 days of receipt or other period as required by law waives the right to request a hearing on such matters.
5. Mediation pursuant to Section 120.573, F.S., to settle an administrative dispute regarding District intended or proposed action is not available prior to the filing of a petition for hearing.
6. A request or petition for administrative hearing must comply with the requirements set forth in Chapter 28.106, F.A.C. A request or petition for a hearing must: (1) explain how the substantial interests of each person requesting the hearing will be affected by the District's intended action or proposed action, (2) state all material facts disputed by the person requesting the hearing or state that there are no material facts in dispute, and (3) otherwise comply with Rules 28-106.201 and 28-106.301, F.A.C. Chapter 28-106, F.A.C. can be viewed at www.flrules.org or at the District's website at www.WaterMatters.org/permits/rules.
7. A petition for administrative hearing is deemed filed upon receipt of the complete petition by the District Agency Clerk at the District's Tampa Service Office during normal business hours, which are 8:00 a.m. to 5:00 p.m., Monday through Friday, excluding District holidays. Filings with the District Agency Clerk may be made by mail, hand-delivery or facsimile transfer (fax). The District does not accept petitions for administrative hearing by electronic mail. Mailed filings must be addressed to, and hand-delivered filings must be delivered to, the Agency Clerk, Southwest Florida Water Management District, 7601 Highway 301 North, Tampa, FL 33637-6759. Faxed filings must be transmitted to the District Agency Clerk at (813) 367-9776. Any petition not received during normal business hours shall be filed as of 8:00 a.m. on the next business day. The District's acceptance of faxed petitions for filing is subject to certain conditions set forth in the District's Statement of Agency Organization and Operation, available for viewing at www.WaterMatters.org/about.

JUDICIAL REVIEW

1. Pursuant to Sections 120.60(3) and 120.68, F.S., a party who is adversely affected by District action may seek judicial review of the District's action. Judicial review shall be sought in the Fifth District Court of Appeal or in the appellate district where a party resides or as otherwise provided by law.
2. All proceedings shall be instituted by filing an original notice of appeal with the District Agency Clerk within 30 days after the rendition of the order being appealed, and a copy of the notice of appeal, accompanied by any filing fees prescribed by law, with the clerk of the court, in accordance with Rules 9.110 and 9.190 of the Florida Rules of Appellate Procedure (Fla. R. App. P.). Pursuant to Fla. R. App. P. 9.020(h), an order is rendered when a signed written order is filed with the clerk of the lower tribunal.